

Technical drawing of a 250 KVA transformer and its associated switchgear, showing three views: front, side, and top.

Front View (Top): Shows the transformer with a 400A rating and 250 KVA. The switchgear is labeled 250 KVA and 400A. Dimensions: 1600 mm (width) and 1000 mm (height).

Side View (Middle): Shows the transformer and switchgear from the side. Dimensions: 1600 mm (width) and 1000 mm (height).

Top View (Bottom): Shows the transformer and switchgear from above. Dimensions: 1600 mm (width) and 450 mm (depth).

Dimensions: 1600x1000x450mm


Legend:

ÇİZEN	Aslı YILDIRIM	İMZA:	PROJE	SEDAŞ	SAYFA
KONTROL	Muzafer OLGUN	İMZA:	PAFTA	TR 250KVA AG GÜÇ PANOSU	ARŞİV
ONAY	Muzafer OLGUN	İMZA:		3 HAT ŞEMASI	PNB-AG-250D

ÖLÇEK 00

REVİZYON 00


27.09.2022

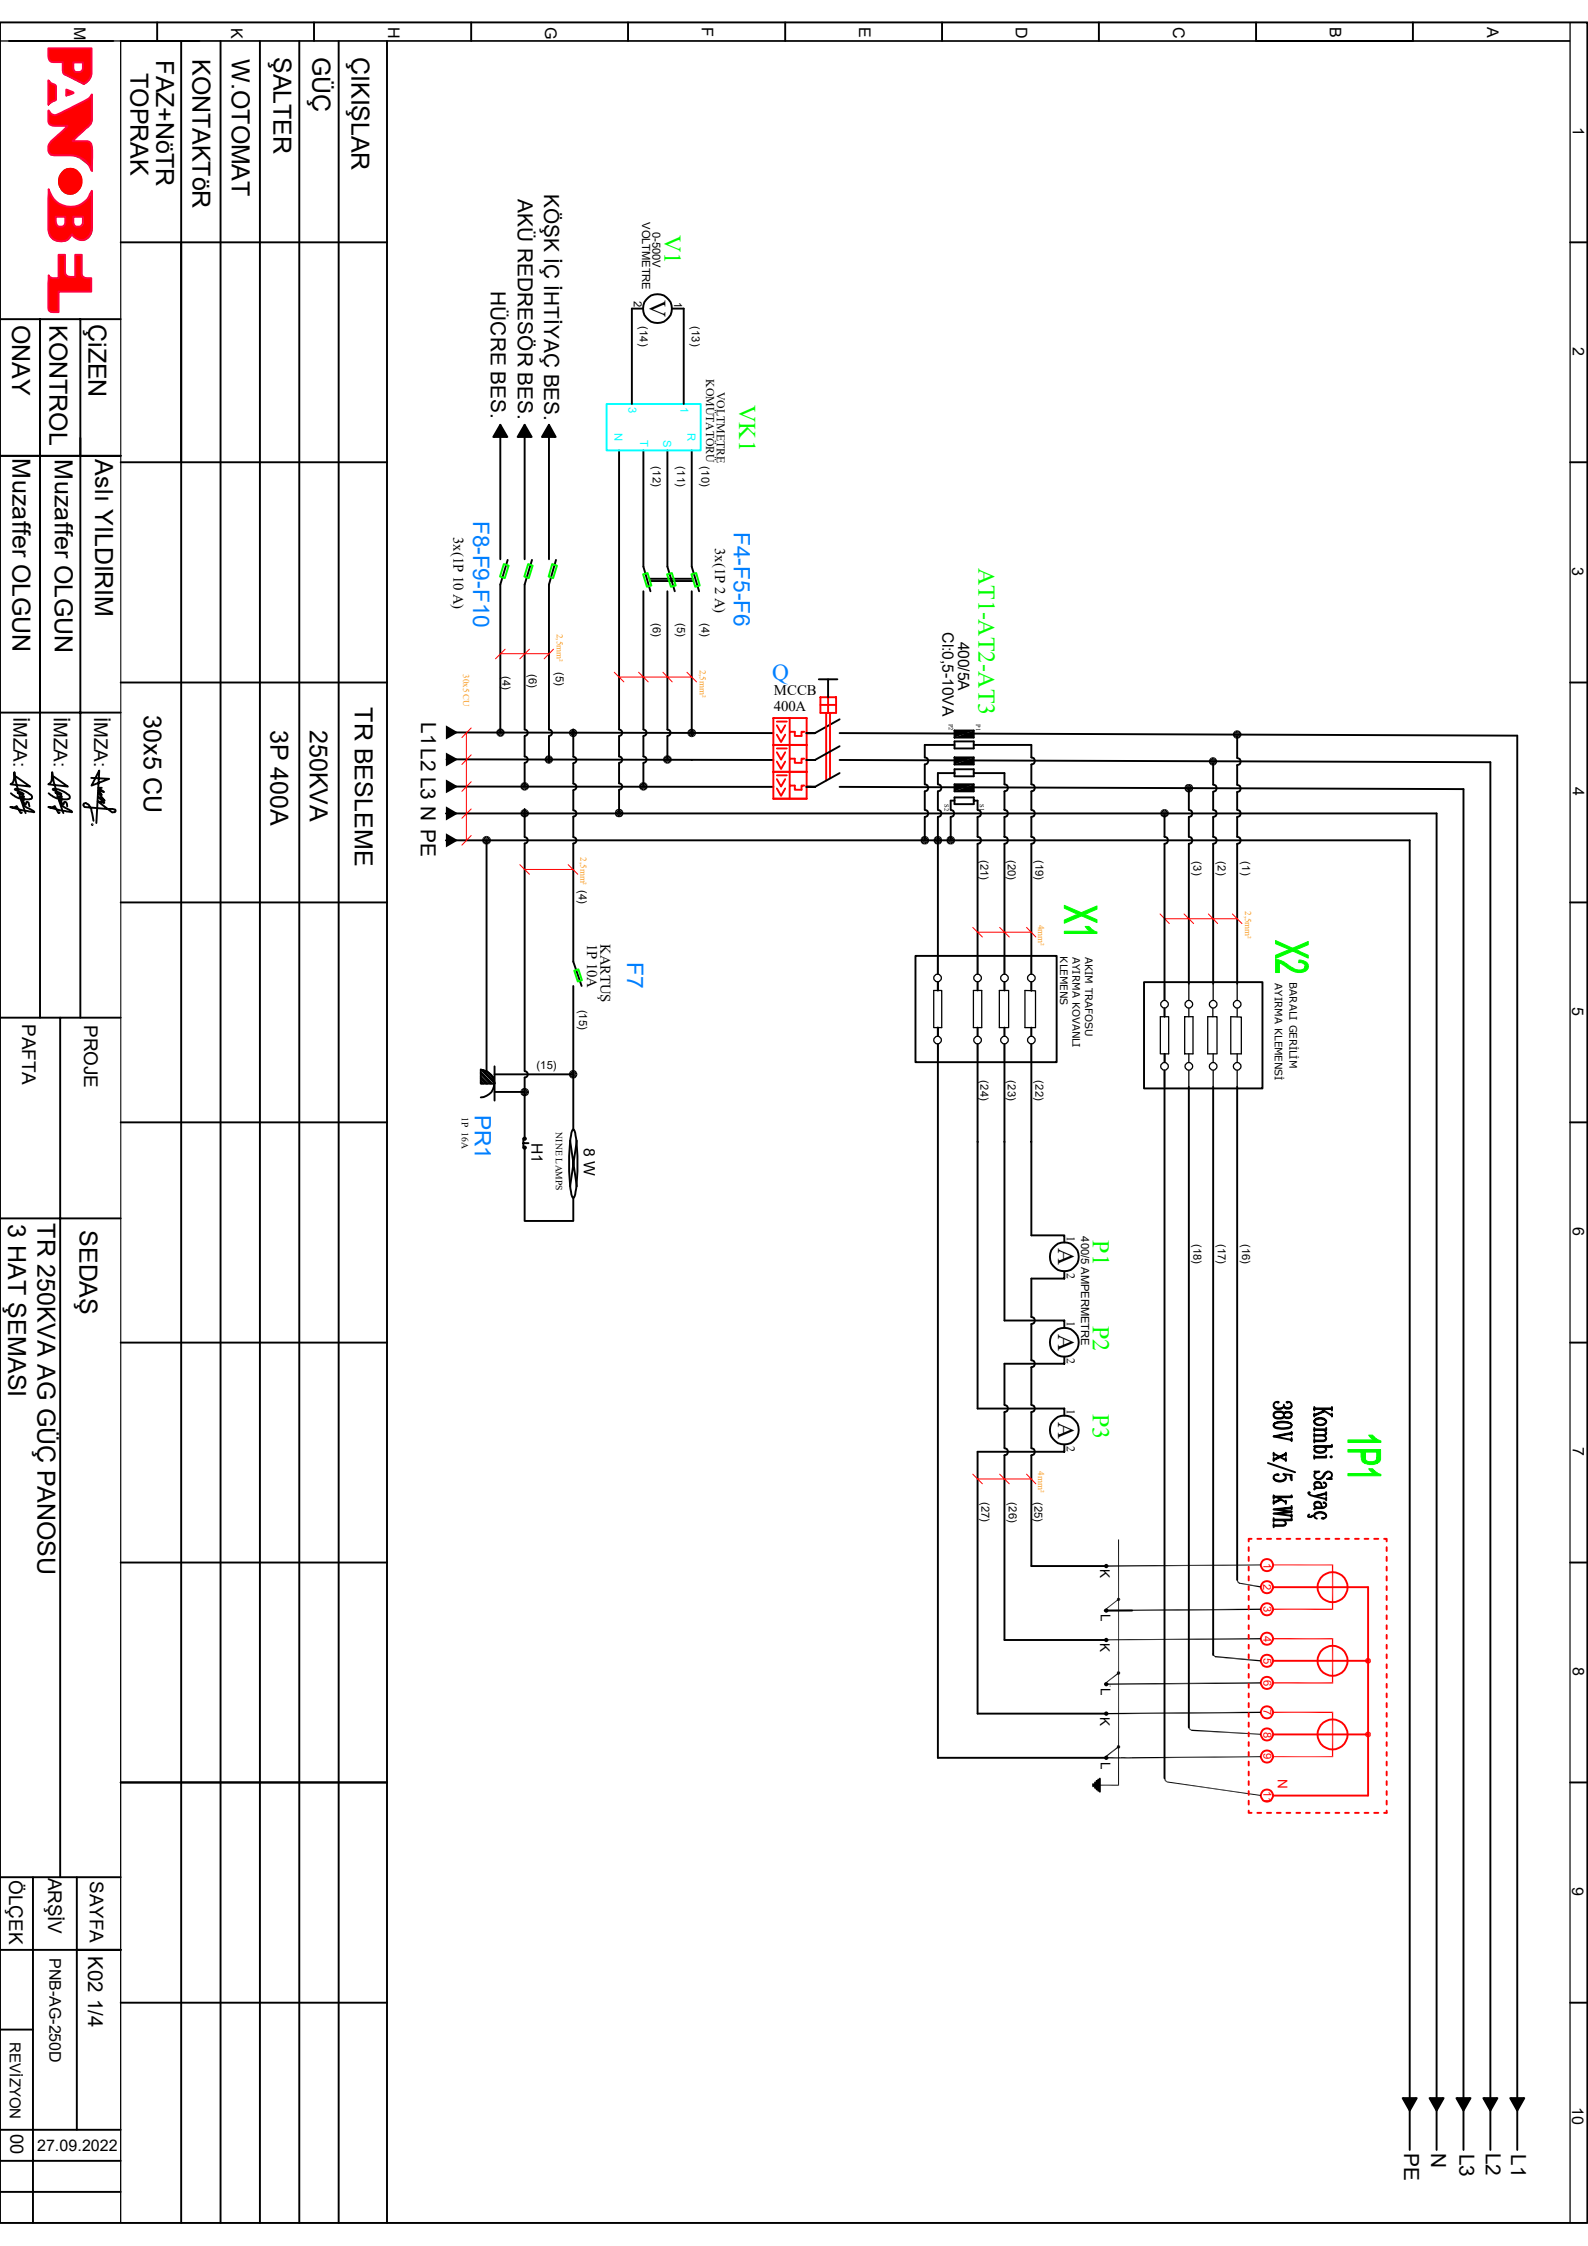


MODEM İÇ YAPISI VE ÖZELLİKLERİ

1. İki adet rölesi (her röle nc ve no çıkışlı) olmalı
2. İki adet RS485 haberleşme portu olmalı
3. RS485-1 üzerinden sayacı haberleşme yapılabilir
4. Modemin 1. rölesi astro zamana uygun çalışmalıdır
5. Modemin 2. rölesi sürekli çekili konumda kalmalıdır
6. Modemde en az 4 adet input olmalı
7. Input-2 kontakör durumundan input-3 pano kapağı switch durumundan bildirimlerini almalıdır

PAKO ŞALTER İÇ YAPISI



Kontakör Devre Dışı	1	2	3	4
Modem Devrede	X			
Kontakör Devrede			X	



NOT : BUTER HAT SADECE MODEM, KONTAKTÖR, PAKO, ASTRO RÖLE NİN BAĞLANTILARININ NASIL YAPILDIĞINI GÖSTERMEK İÇİN ÇİZİLMİŞTİR. ÇEVRE SİGORTA, KONTAKTÖR AKIM DEĞERLERİ VE TİPİ PANO PROJESİNDEN BAĞLIYALDIR. KULLANILACAK SİGORTALAR KARTUŞ TİPİ OLMALIDIR.

