



[illegible]

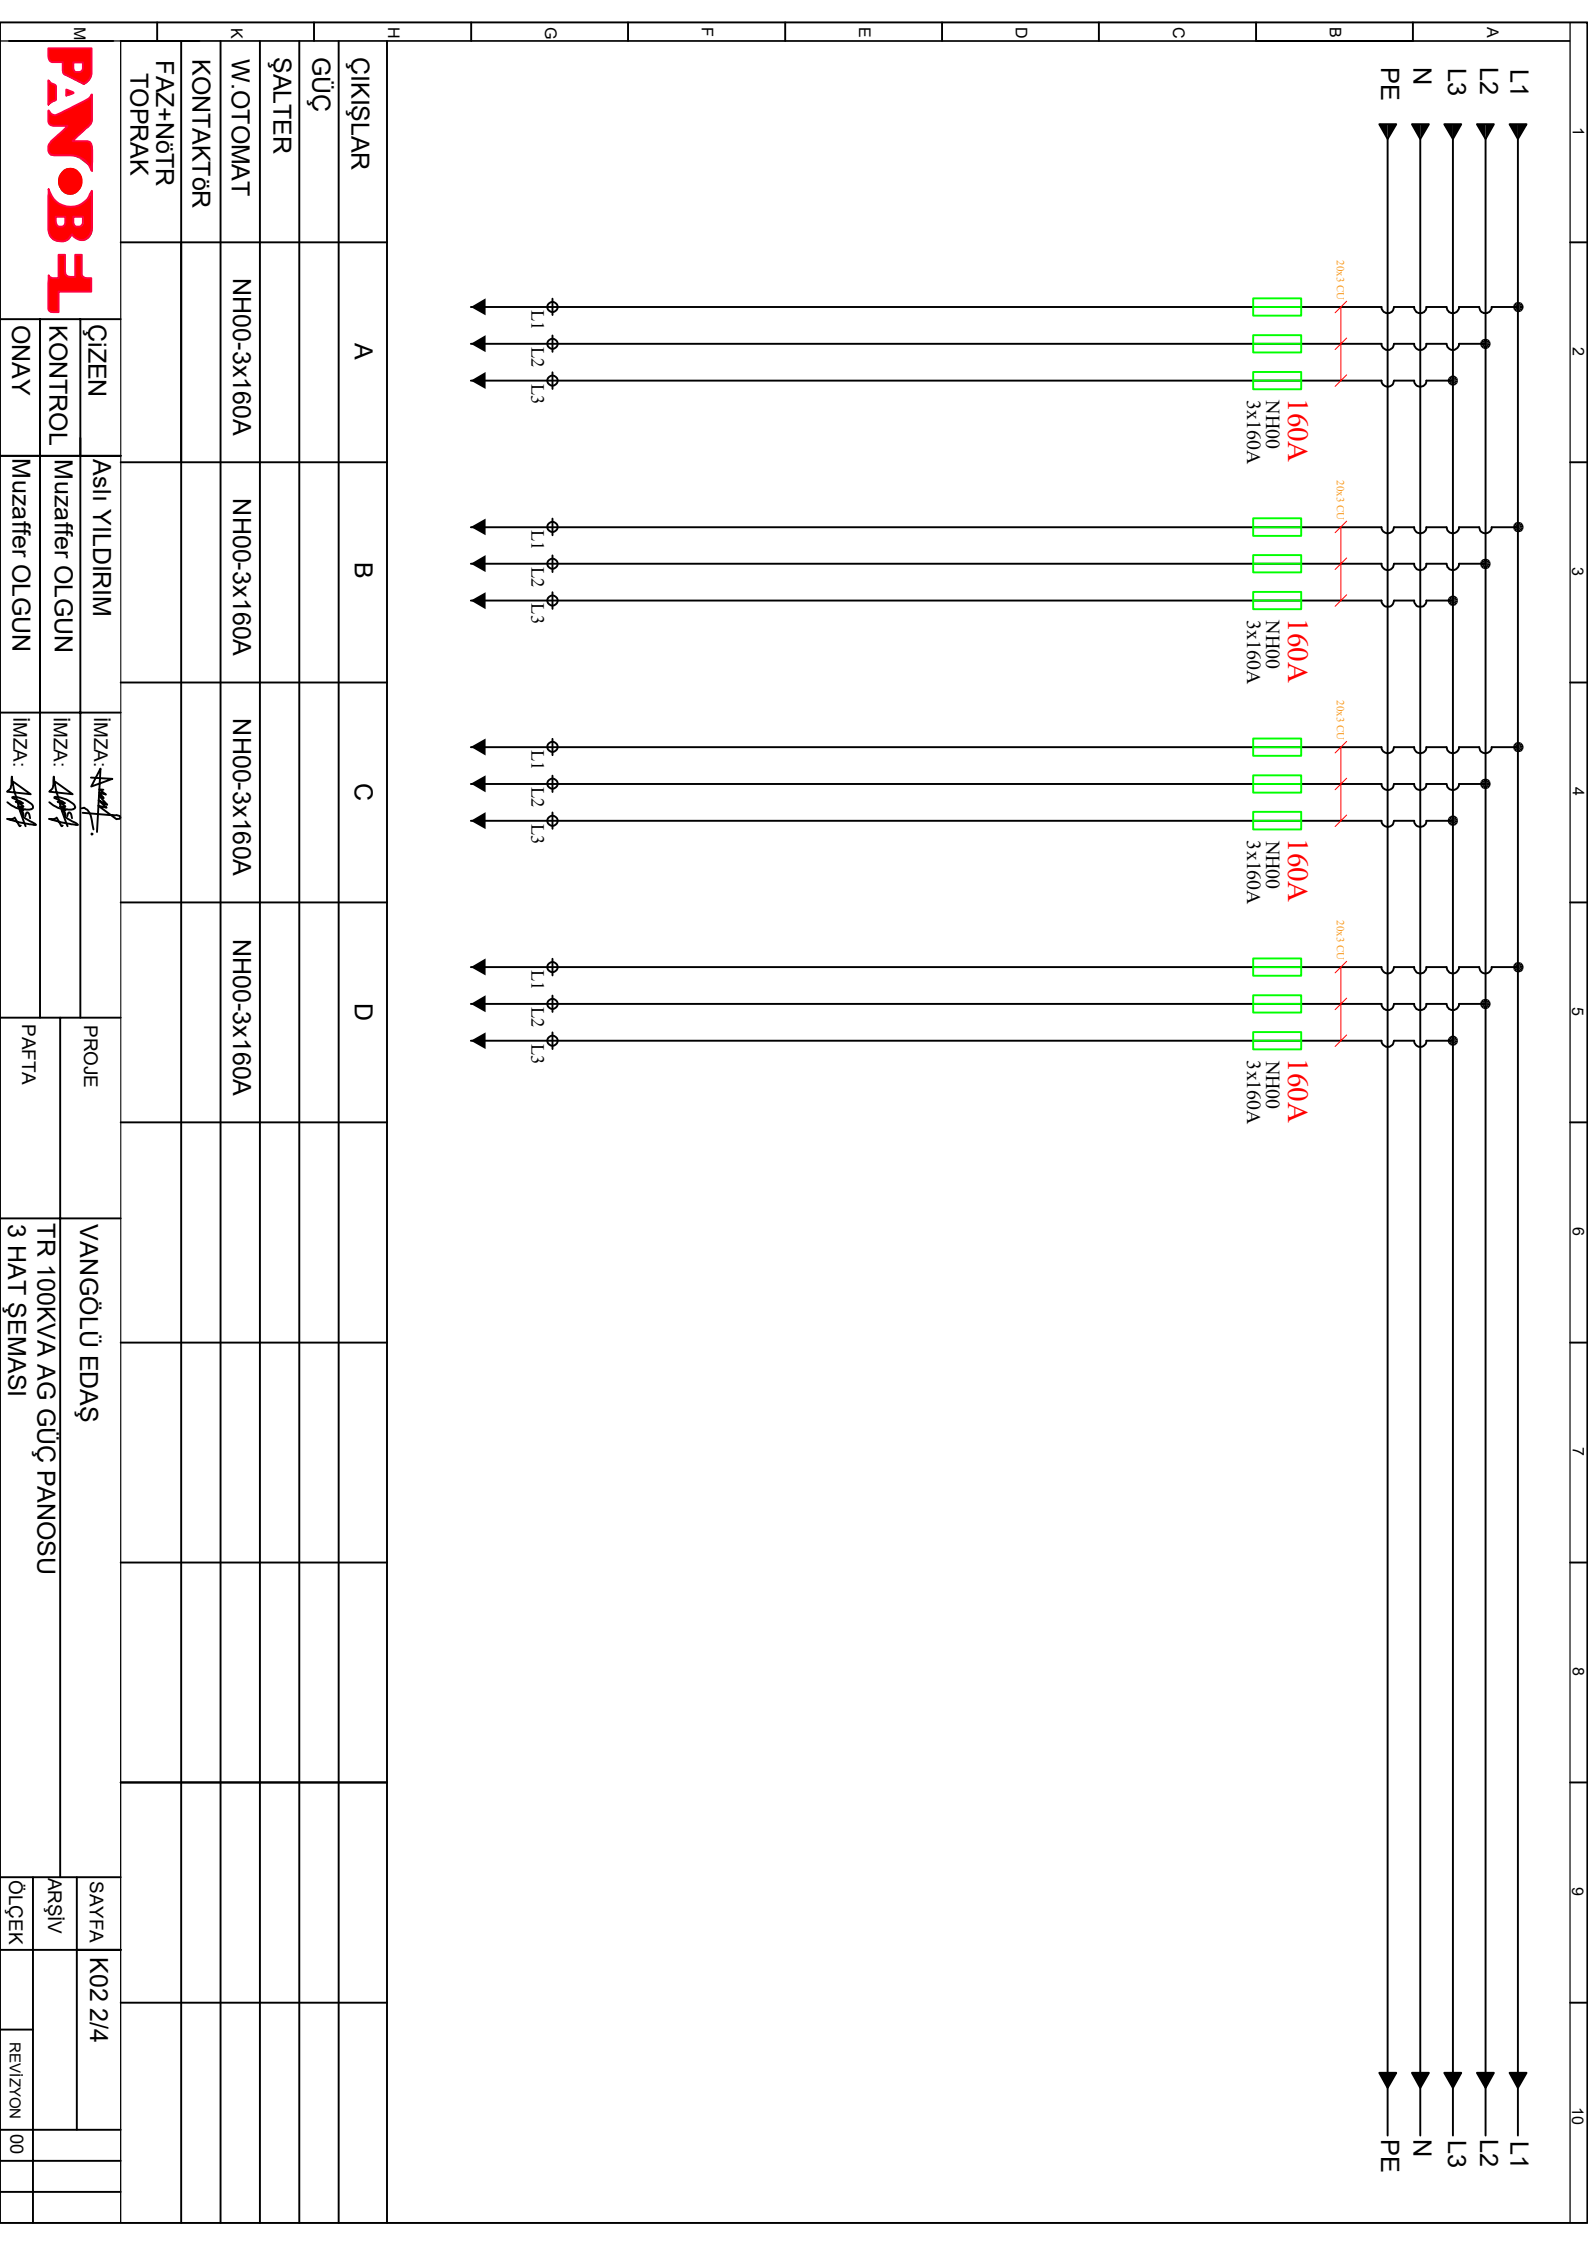

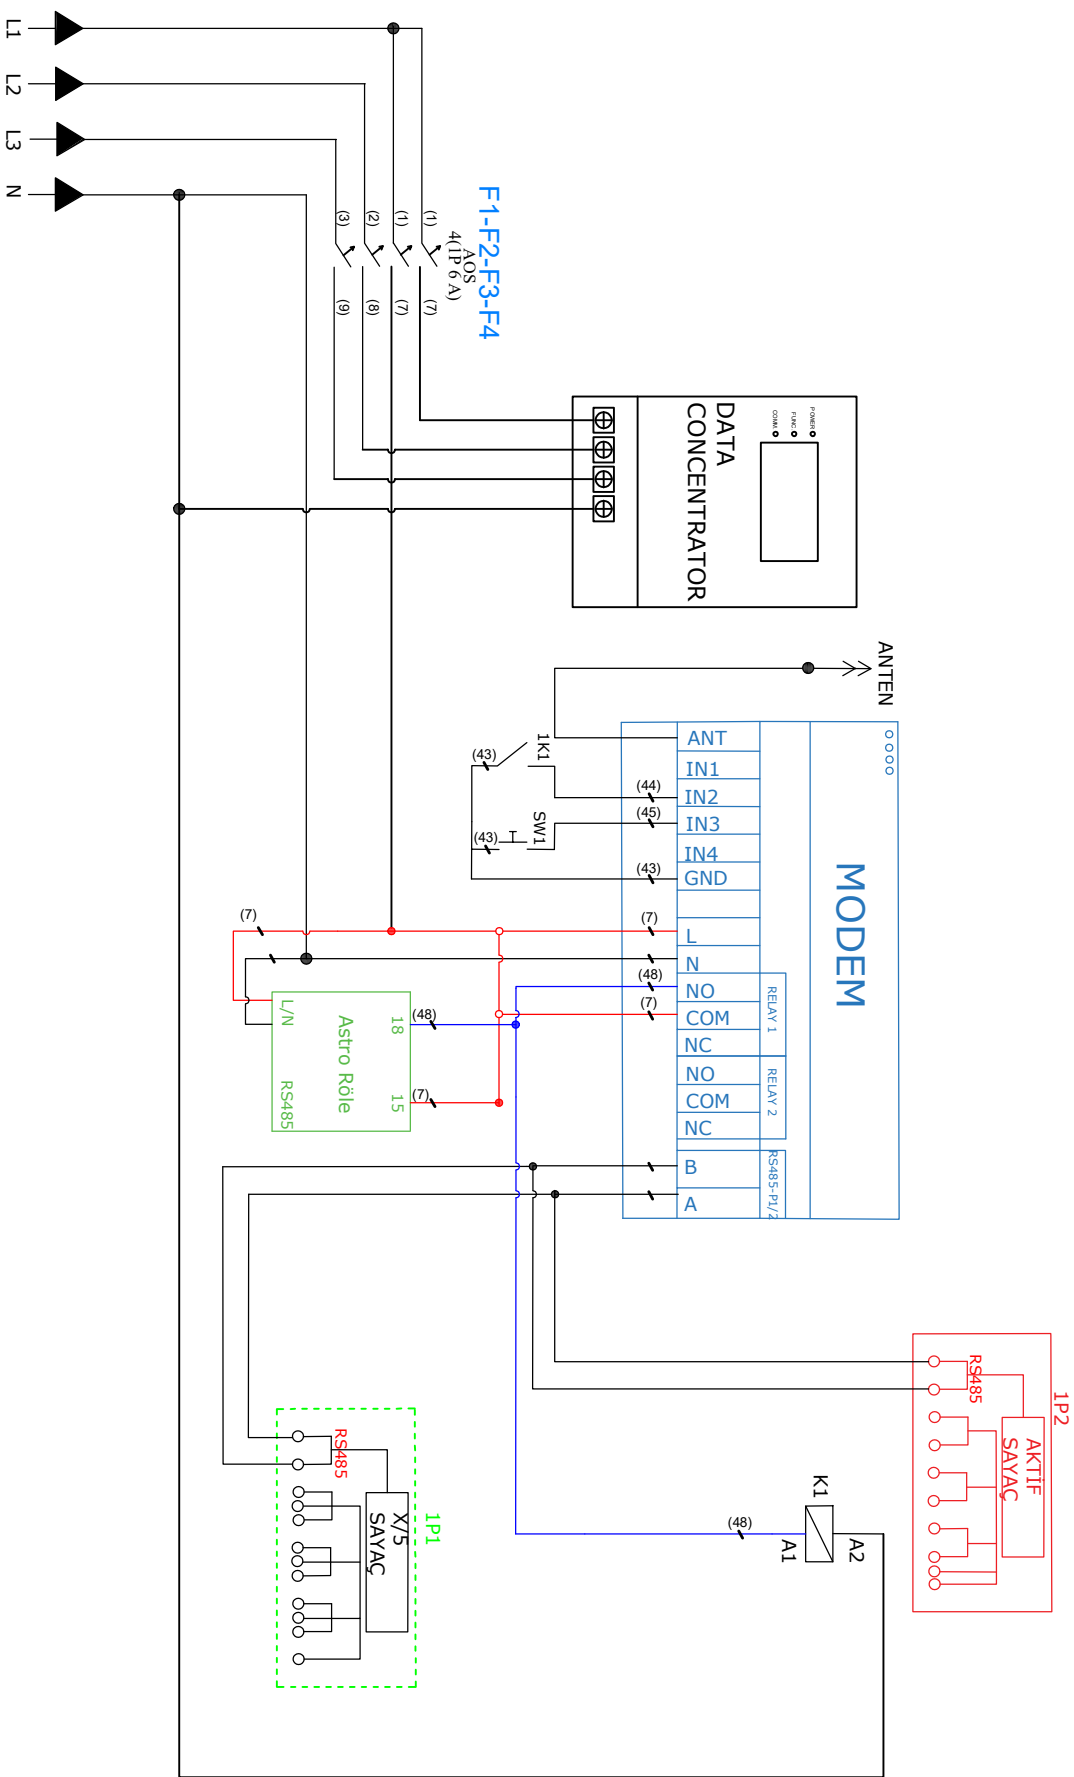

NOT : BU TEK HAT SADECE MODERN, KONTAKTÖR, ASTRO RÖLE'NİN BAĞLANTILARININ MSİL YAPILDIĞINI GÖSTERMEK İÇİN ÇİZİLMİŞTİR. ÇEVRE SİĞORTA, KONTAKTÖR AKIM DEĞERLERİ VE TİPİLERİ PANO PROJESİNDEN BAKILMALIDIR. KULLANILACAK SİĞORTALAR VE OTOMAT TİPİ OLMAKTADIR.

Diagram illustrating the wiring connections for a 3-phase power supply (L1, L2, L3, N) to a Data Concentrator, Modem, and various relays (K1, K2, K3, K4, K5, K6, K7, K8, K9, K10, K11, K12, K13, K14, K15, K16, K17, K18, K19, K20, K21, K22, K23, K24, K25, K26, K27, K28, K29, K30, K31, K32, K33, K34, K35, K36, K37, K38, K39, K40, K41, K42, K43, K44, K45, K46, K47, K48, K49, K50, K51, K52, K53, K54, K55, K56, K57, K58, K59, K60, K61, K62, K63, K64, K65, K66, K67, K68, K69, K70, K71, K72, K73, K74, K75, K76, K77, K78, K79, K80, K81, K82, K83, K84, K85, K86, K87, K88, K89, K90, K91, K92, K93, K94, K95, K96, K97, K98, K99, K100).

The diagram shows the following components and connections:

- 3-Phase Power Supply (L1, L2, L3, N):** Connected to the Data Concentrator and the Modem.
- Data Concentrator:** Connected to the Modem via a 4-core cable (F1-F2-F3-F4).
- Modem:** Connected to the Data Concentrator and the 3-phase power supply. It includes a 1P2 (1P/2P) terminal block.
- Relays (K1, K2, K3, K4, K5, K6, K7, K8, K9, K10, K11, K12, K13, K14, K15, K16, K17, K18, K19, K20, K21, K22, K23, K24, K25, K26, K27, K28, K29, K30, K31, K32, K33, K34, K35, K36, K37, K38, K39, K40, K41, K42, K43, K44, K45, K46, K47, K48, K49, K50, K51, K52, K53, K54, K55, K56, K57, K58, K59, K60, K61, K62, K63, K64, K65, K66, K67, K68, K69, K70, K71, K72, K73, K74, K75, K76, K77, K78, K79, K80, K81, K82, K83, K84, K85, K86, K87, K88, K89, K90, K91, K92, K93, K94, K95, K96, K97, K98, K99, K100):** Connected to the 3-phase power supply and the Modem.
- Relay K1:** Connected to the 3-phase power supply and the Modem.
- Relay K2:** Connected to the 3-phase power supply and the Modem.
- Relay K3:** Connected to the 3-phase power supply and the Modem.
- Relay K4:** Connected to the 3-phase power supply and the Modem.
- Relay K5:** Connected to the 3-phase power supply and the Modem.
- Relay K6:** Connected to the 3-phase power supply and the Modem.
- Relay K7:** Connected to the 3-phase power supply and the Modem.
- Relay K8:** Connected to the 3-phase power supply and the Modem.
- Relay K9:** Connected to the 3-phase power supply and the Modem.
- Relay K10:** Connected to the 3-phase power supply and the Modem.
- Relay K11:** Connected to the 3-phase power supply and the Modem.
- Relay K12:** Connected to the 3-phase power supply and the Modem.
- Relay K13:** Connected to the 3-phase power supply and the Modem.
- Relay K14:** Connected to the 3-phase power supply and the Modem.
- Relay K15:** Connected to the 3-phase power supply and the Modem.
- Relay K16:** Connected to the 3-phase power supply and the Modem.
- Relay K17:** Connected to the 3-phase power supply and the Modem.
- Relay K18:** Connected to the 3-phase power supply and the Modem.
- Relay K19:** Connected to the 3-phase power supply and the Modem.
- Relay K20:** Connected to the 3-phase power supply and the Modem.
- Relay K21:** Connected to the 3-phase power supply and the Modem.
- Relay K22:** Connected to the 3-phase power supply and the Modem.
- Relay K23:** Connected to the 3-phase power supply and the Modem.
- Relay K24:** Connected to the 3-phase power supply and the Modem.
- Relay K25:** Connected to the 3-phase power supply and the Modem.
- Relay K26:** Connected to the 3-phase power supply and the Modem.
- Relay K27:** Connected to the 3-phase power supply and the Modem.
- Relay K28:** Connected to the 3-phase power supply and the Modem.
- Relay K29:** Connected to the 3-phase power supply and the Modem.
- Relay K30:** Connected to the 3-phase power supply and the Modem.
- Relay K31:** Connected to the 3-phase power supply and the Modem.
- Relay K32:** Connected to the 3-phase power supply and the Modem.
- Relay K33:** Connected to the 3-phase power supply and the Modem.
- Relay K34:** Connected to the 3-phase power supply and the Modem.
- Relay K35:** Connected to the 3-phase power supply and the Modem.
- Relay K36:** Connected to the 3-phase power supply and the Modem.
- Relay K37:** Connected to the 3-phase power supply and the Modem.
- Relay K38:** Connected to the 3-phase power supply and the Modem.
- Relay K39:** Connected to the 3-phase power supply and the Modem.
- Relay K40:** Connected to the 3-phase power supply and the Modem.
- Relay K41:** Connected to the 3-phase power supply and the Modem.
- Relay K42:** Connected to the 3-phase power supply and the Modem.
- Relay K43:** Connected to the 3-phase power supply and the Modem.
- Relay K44:** Connected to the 3-phase power supply and the Modem.
- Relay K45:** Connected to the 3-phase power supply and the Modem.
- Relay K46:** Connected to the 3-phase power supply and the Modem.
- Relay K47:** Connected to the 3-phase power supply and the Modem.
- Relay K48:** Connected to the 3-phase power supply and the Modem.
- Relay K49:** Connected to the 3-phase power supply and the Modem.
- Relay K50:** Connected to the 3-phase power supply and the Modem.
- Relay K51:** Connected to the 3-phase power supply and the Modem.
- Relay K52:** Connected to the 3-phase power supply and the Modem.
- Relay K53:** Connected to the 3-phase power supply and the Modem.
- Relay K54:** Connected to the 3-phase power supply and the Modem.
- Relay K55:** Connected to the 3-phase power supply and the Modem.
- Relay K56:** Connected to the 3-phase power supply and the Modem.
- Relay K57:** Connected to the 3-phase power supply and the Modem.
- Relay K58:** Connected to the 3-phase power supply and the Modem.
- Relay K59:** Connected to the 3-phase power supply and the Modem.
- Relay K60:** Connected to the 3-phase power supply and the Modem.
- Relay K61:** Connected to the 3-phase power supply and the Modem.
- Relay K62:** Connected to the 3-phase power supply and the Modem.
- Relay K63:** Connected to the 3-phase power supply and the Modem.
- Relay K64:** Connected to the 3-phase power supply and the Modem.
- Relay K65:** Connected to the 3-phase power supply and the Modem.
- Relay K66:** Connected to the 3-phase power supply and the Modem.
- Relay K67:** Connected to the 3-phase power supply and the Modem.
- Relay K68:** Connected to the 3-phase power supply and the Modem.
- Relay K69:** Connected to the 3-phase power supply and the Modem.
- Relay K70:** Connected to the 3-phase power supply and the Modem.
- Relay K71:** Connected to the 3-phase power supply and the Modem.
- Relay K72:** Connected to the 3-phase power supply and the Modem.
- Relay K73:** Connected to the 3-phase power supply and the Modem.
- Relay K74:** Connected to the 3-phase power supply and the Modem.
- Relay K75:** Connected to the 3-phase power supply and the Modem.
- Relay K76:** Connected to the 3-phase power supply and the Modem.
- Relay K77:** Connected to the 3-phase power supply and the Modem.
- Relay K78:** Connected to the 3-phase power supply and the Modem.
- Relay K79:** Connected to the 3-phase power supply and the Modem.
- Relay K80:** Connected to the 3-phase power supply and the Modem.
- Relay K81:** Connected to the 3-phase power supply and the Modem.
- Relay K82:** Connected to the 3-phase power supply and the Modem.
- Relay K83:** Connected to the 3-phase power supply and the Modem.
- Relay K84:** Connected to the 3-phase power supply and the Modem.
- Relay K85:** Connected to the 3-phase power supply and the Modem.
- Relay K86:** Connected to the 3-phase power supply and the Modem.
- Relay K87:** Connected to the 3-phase power supply and the Modem.
- Relay K88:** Connected to the 3-phase power supply and the Modem.
- Relay K89:** Connected to the 3-phase power supply and the Modem.
- Relay K90:** Connected to the 3-phase power supply and the Modem.
- Relay K91:** Connected to the 3-phase power supply and the Modem.
- Relay K92:** Connected to the 3-phase power supply and the Modem.
- Relay K93:** Connected to the 3-phase power supply and the Modem.
- Relay K94:** Connected to the 3-phase power supply and the Modem.
- Relay K95:** Connected to the 3-phase power supply and the Modem.
- Relay K96:** Connected to the 3-phase power supply and the Modem.
- Relay K97:** Connected to the 3-phase power supply and the Modem.
- Relay K98:** Connected to the 3-phase power supply and the Modem.
- Relay K99:** Connected to the 3-phase power supply and the Modem.
- Relay K100:** Connected to the 3-phase power supply and the Modem.

NOT : BU TEK HAT SADECE MODEM, KONTAKTOR, ASTRO RÖLE NİN BAĞLANTILARININ NASIL YAPILDIĞINI GÖSTERMEK İÇİN ÇİZİLMİŞTİR. ÇEVRE SİGORTA, KONTAKTÖR AKIM DEĞERLERİ VE TİPİLERİ PANO PROJESİNDEN BAKILMALIDIR. KULLANILACAK SİGORTALAR W OTOMAT TİPİ OLMALIDIR.